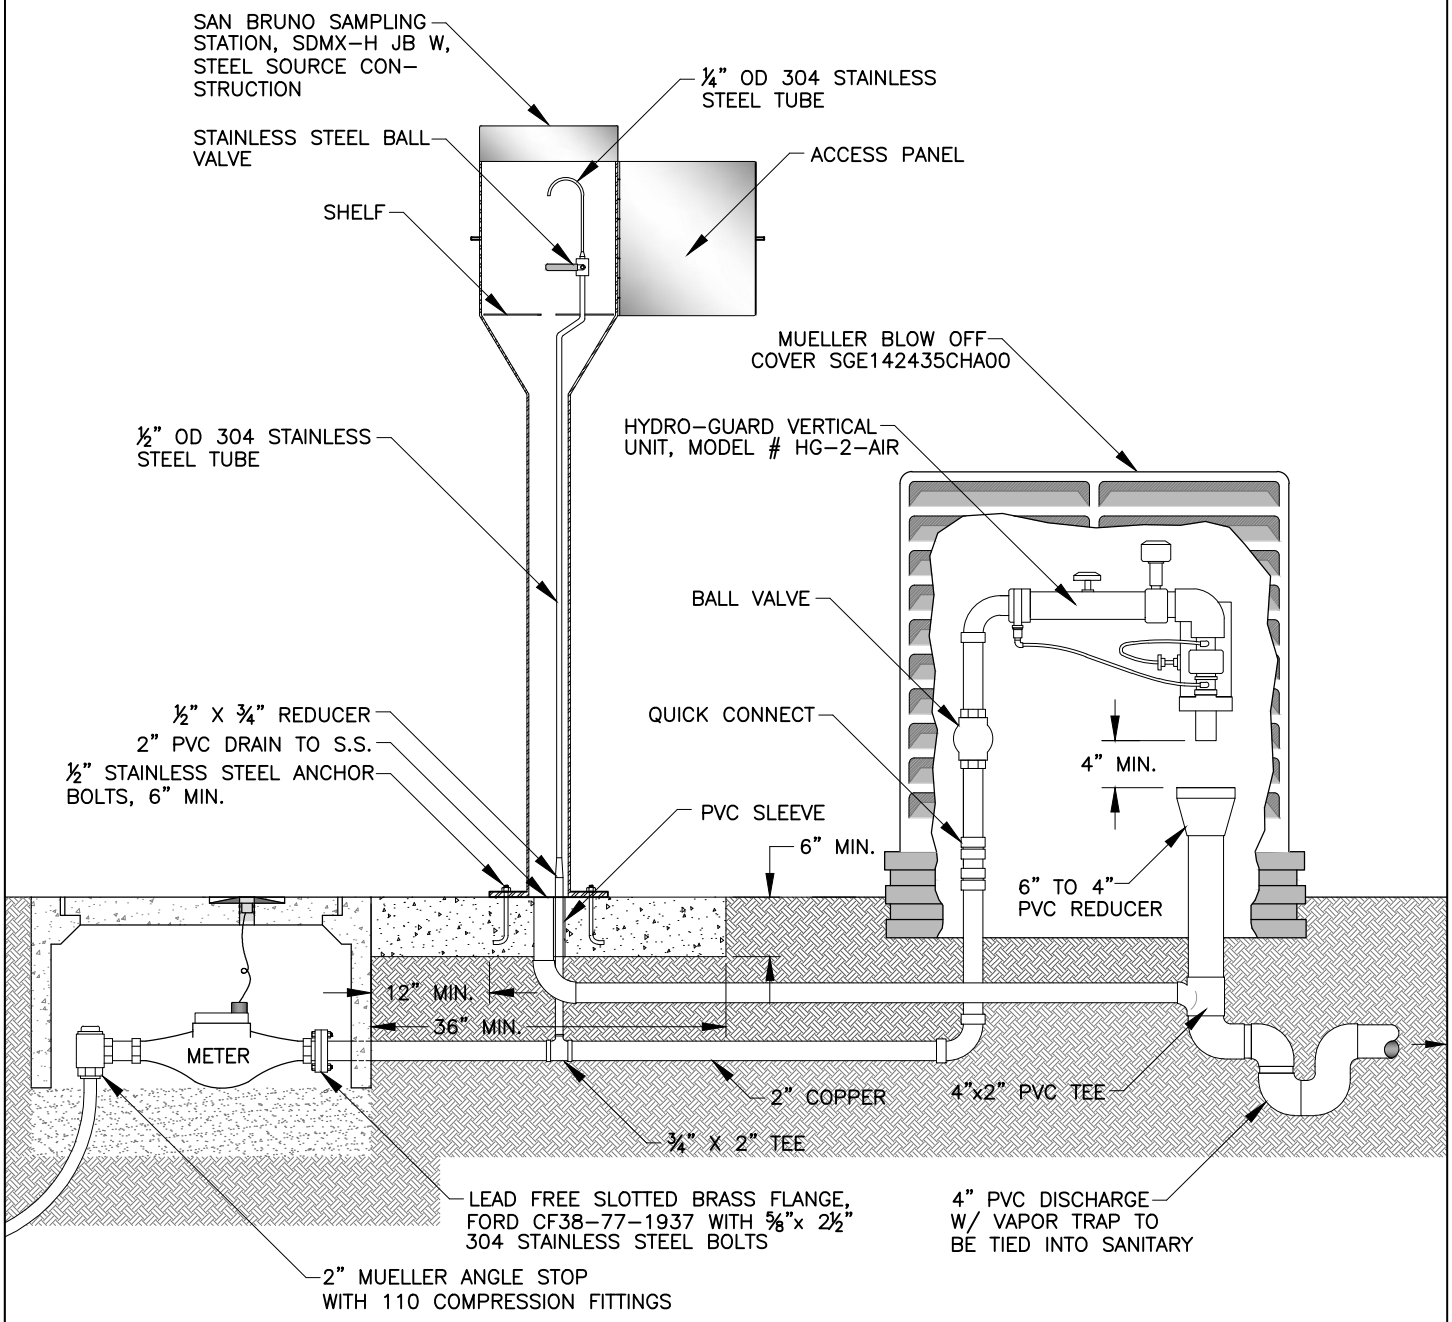

NOTES:

1. ALL FITTINGS TO BE COPPER OR RED BRASS.
2. AUTOMATIC BLOW–OFF ASSEMBLIES ARE TO BE PLACED AT ALL WATER MAIN DEAD ENDS OR WHERE CIRCULATION IS LIMITED.

City of San Bruno *Standard Detail*	SAMPLE STATION AND AUTOMATIC BLOW OFF	DATE: AUG 2024 DRAWN BY: JMH
	CITY ENGINEER: APPROVED BY: HAE WON RITCHIE R.C.E. C69532	W–12 DETAIL NO: